




# Straight Talk On Tanks

## Leak Detection Methods For Petroleum Underground Storage Tanks And Piping

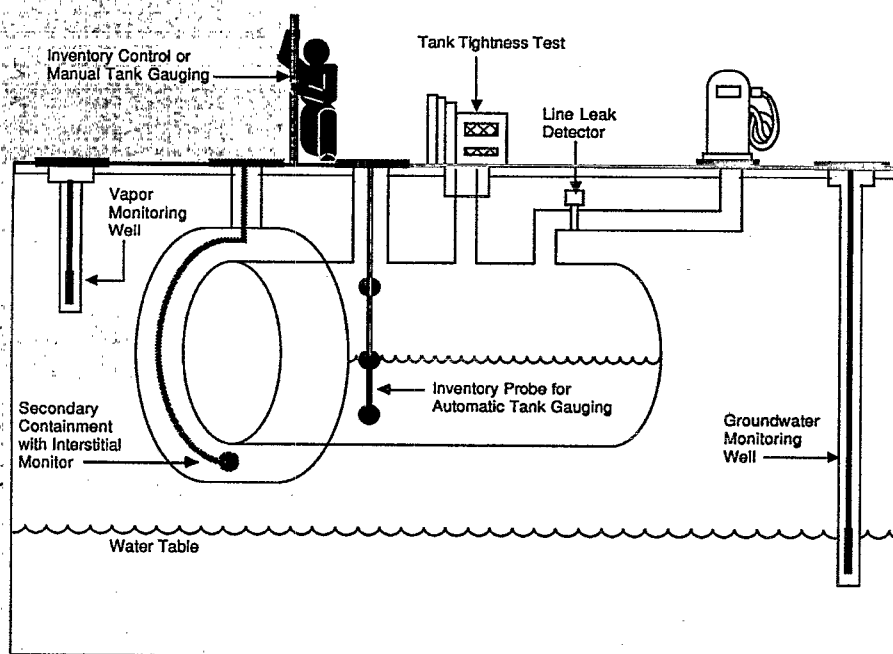

## Contents

Do You Have Questions About Leak Detection?	1
An Overview Of Leak Detection Requirements	2
Secondary Containment With Interstitial Monitoring	6
Automatic Tank Gauging Systems	8
Vapor Monitoring	10
Groundwater Monitoring	12
Structural Inventory Reconciliation	14
Tank Integrity Testing With Inventory Control	16
Manual Tank Gauging	20
Leak Detection For Underground Piping	22
Publications And Videos About USTs	26
Start Sources For UST Information	28

### Free Publications About UST Requirements

You can go to EPA's UST Web site at <http://www.epa.gov/oust/> to order or read documents online. You can call EPA's toll-free RCEPA Superfund Hotline at 800-424-9346 and order up to 30 free copies of any title. Or you can write and ask for them, addressing your request to NCEPI, our publication distribution NOEPI, Box 42419, Cincinnati, OH 45242. Or you can make your request by calling NCEPI's toll-free number at 800-490-9198. Or you can fax your order to NOEPI at 518-591-6685.

## Do You Have Questions About Leak Detection?

As an owner or operator of underground storage tanks (USTs) storing petroleum:

- Do you understand the basic leak detection requirements for USTs?
- Do you need help choosing the best leak detection method for your USTs?

These are important questions, because your UST and its underground piping must have leak detection **NOW**.

This booklet begins with an overview of the federal regulatory requirements for leak detection. Each following section focuses on one leak detection method or the special requirements for piping.

You will find answers in this booklet to many basic questions about how leak detection methods work and which methods are best for your UST site.


### ***Why is leak detection so important?***

As of March 1997, almost 330,000 UST leaks had been confirmed. At sites without leak detection, leaks were discovered late, after contamination had spread, requiring difficult and costly cleanups.

By contrast, if you have effective leak detection, you can respond quickly to signs of leaks. You can minimize the extent of environmental damage and the threat to human health and safety. Early action on your part also protects you from the high costs that can result from cleaning up extensive leaks and responding to third-party liability claims.

If you need an overview of all the federal requirements for USTs, please refer to **Musts For USTs**, a booklet developed by the U.S. Environmental Protection Agency (EPA). You can order a free copy of this booklet by calling EPA's toll-free Hotline at 800 424-9346 (see inside the front cover for full ordering information).

***If your USTs do not meet the leak detection requirements described in this booklet, you can be cited for violations and fined.***

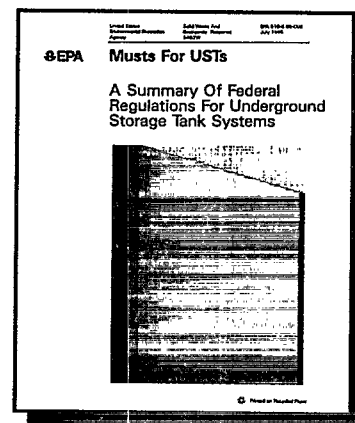

## An Overview Of Leak Detection Requirements

**All new USTs** (those installed after December 1988) must have leak detection when they are installed.

USTs installed before December 1988 (called "existing USTs") had compliance deadlines for leak detection phased in over 5 years. **By December 1993, all "existing USTs" had to have leak detection.**

EPA has identified the following methods that owners and operators may use to meet the federal leak detection requirements:

- Secondary Containment With Interstitial Monitoring
- Automatic Tank Gauging Systems
- Vapor Monitoring
- Groundwater Monitoring
- Statistical Inventory Reconciliation
- Other Methods Meeting Performance Standards

The leak detection methods noted above are all **monthly monitoring methods** and eventually everyone must use at least one of them. However, as a **temporary** method, you can combine tank tightness testing with inventory control (or with manual tank gauging if you have a small tank), as explained on page 4.


Underground piping connected to your USTs must also have leak detection. See pages 22-25 for descriptions of the requirements for piping.

**Brief descriptions of leak detection methods appear on the next two pages. More complete descriptions appear in the following sections.**

**State or local regulations may differ from the federal requirements, so find out which requirements apply to your UST. See the list of state UST contacts starting on page 28.**


■ **Secondary Containment With Interstitial Monitoring** (see pages 6-7)

Secondary containment often uses a barrier, an outer wall, a vault, or a liner around the UST or piping. Tanks can be equipped with inner bladders that provide secondary containment. Leaked product from the inner tank or piping is directed towards an "interstitial" monitor located between the inner tank or piping and the outer barrier. Interstitial monitoring methods range from a simple dipstick to a continuous, automated vapor or liquid sensor permanently installed in the system.




■ **Automatic Tank Gauging Systems** (see pages 8-9)

A probe permanently installed in the tank is wired to a monitor to provide information on product level and temperature. These systems automatically calculate the changes in product volume that can indicate a leaking tank.




■ **Vapor Monitoring** (see pages 10-11)

Vapor monitoring measures product "fumes" in the soil around the UST to check for a leak. This method requires installation of carefully placed monitoring wells. Vapor monitoring can be performed manually on a periodic basis or continuously using permanently installed equipment.



■ **Groundwater Monitoring** (see pages 12-13)

Groundwater monitoring senses the presence of liquid product floating on the groundwater. This method requires installation of monitoring wells at strategic locations in the ground near the tank and along the piping runs. To discover if leaked product has reached groundwater, these wells can be checked periodically by hand or continuously with permanently installed equipment. This method cannot be used at sites where groundwater is more than 20 feet below the surface.



■ **Statistical Inventory Reconciliation** (see pages 14-15)

In this method, a trained professional uses sophisticated computer software to conduct a statistical analysis of inventory, delivery, and dispensing data, which you must supply regularly.

■ **Other Methods Meeting Performance Standards**

Any technology can be used if it meets a performance standard of detecting a leak of 0.2 gallons per hour with a probability of detection of at least 95 percent and a probability of false alarm of no more than 5 percent. Regulatory authorities can approve another method if you demonstrate that it works as well as one of the methods above and you comply with any condition the authority imposes.

■ **Tank Tightness Testing With Inventory Control** (see pages 16-19)

This method **combines** periodic tank tightness testing with monthly inventory control. Inventory control involves taking measurements of tank contents and recording amount pumped each operating day, as well as reconciling all this data at least once a month. This combined method must also include tightness tests, which are sophisticated tests performed by trained professionals. ***This combined method can be used only temporarily*** (usually for 10 years or less)—see page 19 for time restrictions.

■ **Manual Tank Gauging** (see pages 20-21)

Manual tank gauging can be used only for tanks of 2,000 gallons or less capacity. This method requires keeping the tank undisturbed for at least 36 hours each week, during which the contents of the tank are measured twice at the beginning and twice at the end of the test period. At the end of each week you compare the results to the standards shown on page 21 to see if your tank may be leaking. This method can be used by itself only for tanks up to 1,000 gallons. Tanks between 1,001 and 2,000 gallons can use this method only in combination with periodic tank tightness testing. ***This combined method can be used only temporarily*** (usually for 10 years or less)—see page 21 for time restrictions.

***Make sure the vendor of the leak detection method you use has provided you with evidence that your leak detection meets regulatory requirements for performance.***

***Look For The "Proof" Of A Third-Party Evaluation***

An evaluation performed by a third party (someone who is independent of the manufacturer or vendor of the leak detection system) shows that a leak detection system can work as designed. The evaluation follows required evaluation procedures, and often takes place in a laboratory. EPA and third parties have developed evaluation procedures for all leak detection systems.

Although an evaluation and its resulting documentation are technical, you should be familiar with the evaluation's "results" form and, when provided, its "description" form. You should obtain these forms from the leak detection vendor and keep them on file. They contain a signed certification that the system performed as described, as well as documenting any limitations of the system. This information is important to your compliance with the UST requirements. For example, if a tank tightness test was evaluated and certified only for tests taking 2 hours or more, then your UST must be tested for at least 2 hours or it would fail to meet the leak detection requirements.

### ***Required "Probabilities" For Some Leak Detection***

The regulations require not only that leak detection methods be able to detect certain leak rates, but that they also give the correct answer consistently. In general, methods must detect the specified leak rate with a probability of detection of at least 95 percent and a probability of false alarm of no more than 5 percent. Simply stated, this means that, of 100 tests of USTs leaking at the specified rate, at least 95 of them must be correctly detected. It also means that, of 100 tests of non-leaking USTs, no more than 5 can be incorrectly called leaking. This is what is meant by the "probabilities" noted in this booklet.

### ***Which leak detection method is best for you?***

There is no one leak detection system that is best for all sites, nor is there a particular type of leak detection that is consistently the least expensive. Each leak detection method has unique characteristics. For example, vapor detection devices work rapidly and most effectively in porous soils, while liquid detectors are only appropriate for areas with a high water table.

Identifying the best leak detection choice for your UST depends on a number of factors including cost (both initial installation cost and long-term operation and maintenance cost), facility configuration (such as complexity of piping runs and manifolded tanks), groundwater depth, soil type, seasonal rainfall and temperature ranges, availability of experienced installers, and other variables.

You should look around extensively for experienced, professional vendors and installers of leak detection. Ask questions that help you find the most reliable, cost-effective leak detection for your type of facility. Some possible information sources are: references from fellow UST owners, oil marketers, equipment suppliers, trade journals, trade associations, state and local trade associations (especially those for petroleum marketers and UST owners), and state and local regulatory authorities. (See the list of state UST contacts starting on page 28.) Your state may also have an assistance fund that may be able to help you pay for your UST's leak detection.


EPA provides a free publication—**List Of Leak Detection Evaluations For UST Systems**—that contains a detailed summary of specifications, based on third-party evaluations, for over 250 leak detection systems. (See inside the front cover for ordering information.) Although the **List** can be used to help select systems and determine their compliance or acceptability, the publication is not a list of "approved" leak detection systems. Approval or acceptance of leak detection systems rests with the implementing agency, in most cases the state environmental agency.

For additional information about federal UST requirements, contact EPA's RCRA/Superfund Hotline at 800 424-9346.

***Some states maintain lists of those leak detection systems that have been evaluated by third parties. Check with your state to see which systems are allowed in your state. See list of state contacts starting on page 28.***

## Secondary Containment With Interstitial Monitoring

### *Will you be in compliance?*

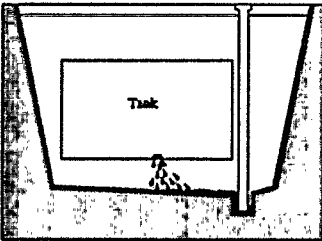

When installed and operated according to the manufacturer's specifications, secondary containment with interstitial monitoring meets the federal leak detection requirements for USTs. Operation of the monitoring device at least once each month fulfills the requirements for the life of the tank. Secondary containment with interstitial monitoring can also be used to detect leaks from piping (see the section on leak detection for piping starting on page 22).

### *How does the leak detection method work?*

#### **Secondary containment**

- Secondary containment provides a barrier between the tank and the environment. The barrier holds the leak between the tank and the barrier so that the leak is detected. The barrier is shaped so that a leak will be directed towards the interstitial monitor.
- Barriers include:
  - ▶ Double-walled or "jacketed" tanks, in which an outer wall partially or completely surrounds the primary tank;
  - ▶ Concrete vaults, with or without lining;
  - ▶ Internally fitted liners ("bladders"); and
  - ▶ Leakproof excavation liners that partially or completely surround the tank.
- Clay and other earthen materials cannot be used as barriers.

#### **Interstitial monitors**

- Monitors are used to check the area between the tank and the barrier for leaks and alert the operator if a leak is suspected.
- Some monitors indicate the physical presence of the leaked product, either liquid or gaseous. Other monitors check for a change in condition that indicates a hole in the tank, such as a loss of vacuum or a change in the level of a monitoring liquid between the walls of a double-walled tank.
- Monitors can be as simple as a dipstick used at the lowest point of the containment to see if liquid product has leaked and pooled there. Monitors can also be sophisticated automated systems that continuously check for leaks.

### ***What are the regulatory requirements?***

- The barrier must be immediately around or beneath the tank.
- The interstitial monitor must be checked at least once every 30 days.
- A double-walled system must be able to detect a release through the inner wall.
- An excavation liner must:
  - ▶ Direct a leak towards the monitor;
  - ▶ Not allow the specific product being stored to pass through it any faster than  $10^{-6}$  cm/sec;
  - ▶ Be compatible with the product stored in the tank;
  - ▶ Not interfere with the UST's cathodic protection;
  - ▶ Not be disabled by moisture;
  - ▶ Always be above the groundwater and the 25-year flood plain; and
  - ▶ Have clearly marked and secured monitoring wells, if they are used.
- A bladder must be compatible with the product stored and must be equipped with an automatic monitoring device.

***Find out if there are state or local requirements on the use of secondary containment that differ from those described here.***

### ***Will it work at your site?***

- In areas with high groundwater or a lot of rainfall, it may be necessary to select a secondary containment system that completely surrounds the tank to prevent moisture from interfering with the monitor.

### ***Anything else you should consider?***

- This method works effectively only if the barrier and the interstitial monitor are installed correctly. Therefore, trained and experienced installers are necessary.

## Automatic Tank Gauging Systems

### *Will you be in compliance?*

When installed and operated according to the manufacturer's specifications, automatic tank gauging systems (ATGS) meet the federal leak detection requirements for **tanks** (this method does not detect piping leaks). A test performed each month fulfills the requirements for the life of the tank. (For additional requirements for piping, see the section on leak detection for piping starting on page 22.)

### *How does the leak detection method work?*


- The product level and temperature in a tank are measured continuously and automatically analyzed and recorded by a computer.
- In the "inventory mode," the ATGS replaces the use of the gauge stick to measure product level and perform inventory control. This mode records the activities of an in-service tank, including deliveries.
- In the "test mode," the tank is taken out of service and the product level and temperature are measured for at least one hour. Some systems, known as "continuous ATGS," do not require the tank to be taken out of service to perform a test. This is because these systems can gather and analyze data during many short periods when no product is being added to or taken from the tank.
- Some methods combine aspects of automatic tank gauges with statistical inventory reconciliation. See pages 14-15 for more information about these methods

### *What are the regulatory requirements?*

- The ATGS must be able to detect a leak of 0.2 gallons per hour with certain probabilities of detection and of false alarm. Some ATGS can also detect a leak of 0.1 gallons per hour with the required probabilities.

### *Will it work at your site?*

- ATGS have been used primarily on tanks containing gasoline or diesel, with a capacity of up to 15,000 gallons. If considering using an ATGS for larger tanks or products other than gasoline or diesel, discuss its applicability with the manufacturer's representative.
- Water around a tank may hide a leak by temporarily preventing the product from leaving the tank. To detect a leak in this situation, the ATGS should be capable of detecting water in the bottom of a tank.

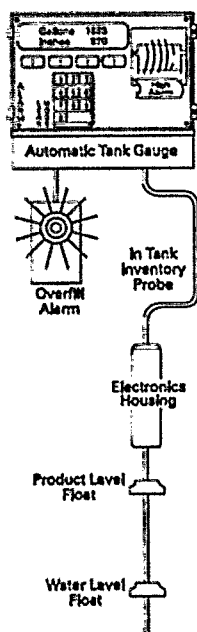

### ***Anything else you should consider?***


- The ATGS probe is permanently installed through an opening (not the fill pipe) on the top of the tank. Each tank at a site must be equipped with a separate probe.
- The ATGS probe is connected to a console that displays ongoing product level information and the results of the monthly test. Printers can be connected to the console to record this information.
- ATGS are often equipped with alarms for high and low product level, high water level, and theft.
- ATGS can be linked with computers at other locations, from which the system can be programmed or read.
- For ATGS that are not of the "continuous" type, no product should be delivered to the tank or withdrawn from it for at least 6 hours before the monthly test or during the test (which generally takes 1 to 6 hours).
- An ATGS can be programmed to perform a test more often than once per month (a recommended practice).

***Find out if there are state or local requirements on the use of ATGS that differ from those described here.***

## Vapor Monitoring

### *Will you be in compliance?*

When installed and operated according to the manufacturer's instructions, vapor monitoring meets the federal leak detection requirements for USTs. Operation of a vapor monitoring system at least once each month fulfills the requirements for the life of the tank. Vapor monitoring can also be installed to detect leaks from piping (see the section on leak detection for piping starting on page 22).

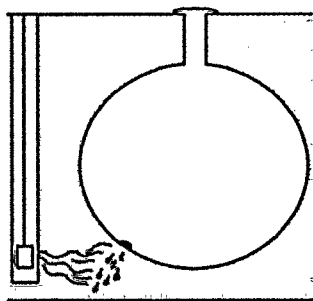

### *How does the leak detection method work?*

- Vapor monitoring senses or measures "fumes" from leaked product in the soil around the tank to determine if the tank is leaking.
- Fully automated vapor monitoring systems have permanently installed equipment to continuously or periodically gather and analyze vapor samples and respond to a release with a visual or audible alarm.
- Manually operated vapor monitoring systems range from equipment that immediately analyzes a gathered vapor sample to devices that gather a sample that must be sent to a laboratory for analysis. Manual systems must be used at least once a month to monitor a site.
- All vapor monitoring devices should be periodically calibrated according to the manufacturer's instructions to ensure that they are properly responding.
- Before installation, a site assessment is necessary to determine the soil type, groundwater depth and flow direction, and the general geology of the site. This can only be done by a trained professional.
- The number of wells and their placement is very important. Only an experienced contractor can properly design and construct an effective monitoring well system. Vapor monitoring requires the installation of monitoring wells within the tank backfill. A minimum of two wells is recommended for a single tank excavation. Three or more wells are recommended for an excavation with two or more tanks. Some state and local agencies have developed regulations for monitoring well placement.

### ***What are the regulatory requirements?***

- The UST backfill must be sand, gravel or another material that will allow the vapors to easily move to the monitor.
- The backfill should be clean enough that previous contamination does not interfere with the detection of a current leak.
- The substance stored in the UST must vaporize easily so that the vapor monitor can detect a release. Some vapor monitoring systems do not work well with diesel fuel.
- High groundwater, excessive rain, or other sources of moisture must not interfere with the operation of vapor monitoring for more than 30 consecutive days.
- Monitoring wells must be secured and clearly marked.

### ***Will it work at your site?***

- Before installing a vapor monitoring system, a site assessment must be done to determine whether vapor monitoring is appropriate at the site. A site assessment usually includes at least a determination of the groundwater level, background contamination, stored product type, and soil type. This assessment can only be done by a trained professional.

***Find out if there are state or local requirements on the use of vapor monitoring that differ from those described here.***

## Groundwater Monitoring

### *Will you be in compliance?*

When installed and operated according to the manufacturer's instructions, a groundwater monitoring system meets the federal leak detection requirements for USTs. Operation of a groundwater monitoring system at least once each month fulfills the requirements for the life of a tank. Groundwater monitoring can also be used to detect leaks in piping (see the section on leak detection for piping starting on page 22).

### *How does the leak detection method work?*

- Groundwater monitoring involves the use of permanent monitoring wells placed close to the UST. The wells are checked at least monthly for the presence of product that has leaked from the UST and is floating on the groundwater surface.
- The two main components of a groundwater monitoring system are the monitoring well (typically a well of 2-4 inches in diameter) and the monitoring device.
- Detection devices may be permanently installed in the well for automatic, continuous measurements for leaked product.
- Detection devices are also available in manual form. Manual devices range from a bailer (used to collect a liquid sample for visual inspection) to a device that can be inserted into the well to electronically indicate the presence of leaked product. Manual devices must be used at least once a month.
- Before installation, a site assessment is necessary to determine the soil type, groundwater depth and flow direction, and the general geology of the site. This assessment can only be done by a trained professional.
- The number of wells and their placement is very important. Only an experienced contractor can properly design and construct an effective monitoring well system. A minimum of two wells is recommended for a single tank excavation. Three or more wells are recommended for an excavation with two or more tanks. Some state and local agencies have developed regulations for monitoring well placement.

**NOTE:**  
*Groundwater monitoring cannot be used at sites where groundwater is more than 20 feet below the surface.*

### ***What are the regulatory requirements?***

- Groundwater monitoring can only be used if the stored substance does not easily mix with water and floats on top of water.
- If groundwater monitoring is to be the sole method of leak detection, the groundwater must not be more than 20 feet below the surface, and the soil between the well and the UST must be sand, gravel or other coarse materials.
- Product detection devices must be able to detect one-eighth inch or less of leaked product on top of the groundwater.
- Monitoring wells must be properly designed and sealed to keep them from becoming contaminated from outside sources. The wells must also be clearly marked and secured.
- Wells should be placed in the UST backfill so that they can detect a leak as quickly as possible.

***Find out if there are state or local requirements on the use of groundwater monitoring that differ from those described here.***

### ***Will it work at your site?***

- In general, groundwater monitoring works best at UST sites where:
  - ▶ Monitoring wells are installed in the tank backfill; and
  - ▶ There are no previous releases of product that would falsely indicate a current release.
- A professionally conducted site assessment is critical for determining these site-specific conditions.

## Statistical Inventory Reconciliation

### *Will you be in compliance?*

Statistical inventory reconciliation (SIR), when performed according to the vendor's specifications, meets federal leak detection requirements for USTs as follows. SIR with a 0.2 gallon per hour leak detection capability meets the federal requirements for monthly monitoring for the life of the tank and piping. SIR with a 0.1 gallon per hour leak detection capability meets the federal requirements as an equivalent to tank tightness testing. SIR can, if it has the capability of detecting even smaller leaks, meet the federal requirements for line tightness testing as well. (For additional requirements for piping, see the section on leak detection for piping starting on page 22.)

### *How does the leak detection method work?*

- SIR analyzes inventory, delivery, and dispensing data collected over a period of time to determine whether or not a tank system is leaking.
- Each operating day, the product level is measured using a gauge stick or other tank level monitor. You also keep complete records of all withdrawals from the UST and all deliveries to the UST. After data have been collected for the period of time required by the SIR vendor, you provide the data to the SIR vendor.
- The SIR vendor uses sophisticated computer software to conduct a statistical analysis of the data to determine whether or not your UST system may be leaking. The SIR vendor provides you with a test report of the analysis.
- Some methods combine aspects of automatic tank gauges with statistical inventory reconciliation. In these methods, sometimes called hybrid methods, a gauge provides liquid level and temperature data to a computer running SIR software, which performs the analysis to detect leaks.

***You can order a free booklet, Introduction To Statistical Reconciliation, that describes the use of this method. See inside the front cover for ordering information.***

### *What are the regulatory requirements?*

- To be allowable as monthly monitoring, a SIR method must be able to detect a leak at least as small as 0.2 gallons per hour and meet the federal regulatory requirements regarding probabilities of detection and of false alarm. Data must be submitted at least monthly.
- To be allowable as an equivalent to tank tightness testing, a SIR method must be able to detect a leak at least as small 0.1 gallons per hour and meet the federal regulatory requirements regarding probabilities of detection and of false alarm.

- The individual SIR method must have been evaluated with a test procedure to certify that it can detect leaks at the required level and with the appropriate probabilities of detection and of false alarm.
- The method's evaluation must reflect the way the method is used in the field. If a SIR method is not performed by the SIR vendor, then the method's evaluation must be done without the involvement of the SIR vendor. Examples of this situation are SIR methods licensed to owners and hybrid ATGS/SIR methods.
- If the test report is not conclusive, you must take the steps necessary to find out conclusively whether your tank is leaking. Because SIR requires multiple days of data, you will probably have to use another method.
- You must keep on file both the test reports and the documentation that the SIR method used is certified as valid for your UST system.

### ***Will it work at your site?***

- SIR has been used primarily on tanks no more than 18,000 gallons in capacity. If you are considering using a SIR method for larger tanks, check the method's evaluation to confirm that it will meet regulatory requirements and your needs.
- A SIR method's ability to detect leaks declines as throughput increases. If you are considering using a SIR method for high throughput UST systems, check the method's evaluation to confirm that it will meet regulatory requirements and your needs.
- Water around a tank may hide a hole in the tank or distort the data to be analyzed by temporarily preventing a leak. To detect a leak in this situation, you should check for water at least once a month.


### ***Anything else you should consider?***

- Data, including product level measurements, dispensing data, and delivery data, should all be carefully collected according to the SIR vendor's specifications. Poor data collection produces inconclusive results and noncompliance.
- The SIR vendor will generally provide forms for recording data, a calibrated chart converting liquid level to volume, and detailed instructions on conducting measurements.
- SIR should not be confused with other release detection methods that also rely on periodic reconciliation of inventory, withdrawal, and delivery data. Unlike manual tank gauging or inventory control, SIR uses a sophisticated statistical analysis of data to detect releases.

***Find out if there are state or local requirements on the use of statistical inventory reconciliation that differ from those described here.***

## Tank Tightness Testing With Inventory Control

### *Will you be in compliance?*

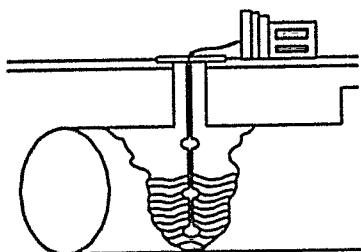

When performed according to the manufacturer's specifications, periodic tank tightness testing combined with monthly inventory control can **temporarily** meet the federal leak detection requirements for **tanks** (this method does not detect piping leaks). See page 19 for time restrictions.

These two leak detection methods must be used together, because neither method alone meets the federal requirements for leak detection for tanks. Tightness testing is also an option for underground piping, as described in the section on leak detection for piping starting on page 22.

Because they must be used together, both tank tightness testing and inventory control are discussed in this section. Tank tightness testing is discussed first, followed by inventory control.

### Tank Tightness Testing

#### *How does the leak detection method work?*

Tightness tests include a wide variety of methods. Other terms used for these methods include "precision," "volumetric," and "nonvolumetric" testing.

- Many tightness test methods are "volumetric" methods in which the change in product level in a tank over time is measured very precisely (in milliliters or thousandths of an inch).
- Other methods use acoustics or tracer chemicals to determine the presence of a hole in the tank. With such methods, all of the factors in the following bullets may not apply.
- For most methods, changes in product temperature also must be measured very precisely (thousandths of a degree) at the same time as level measurements, because temperature changes cause volume changes that interfere with finding a leak.
- For most methods, a net decrease in product volume (subtracting out volume changes caused by temperature) over the time of the test indicates a leak.
- The testing equipment is temporarily installed in the tank, usually through the fill pipe.
- The tank must be taken out of service for the test.
- Many test methods require that the product in the tank be a certain level before testing, which often requires adding product from another tank on-site or purchasing additional product.

- Some tightness test methods require all of the measurements and calculations to be made by hand by the tester. Other tightness test methods are highly automated. After the tester sets up the equipment, a computer controls the measurements and analysis.
- A few methods measure properties of the product that are independent of temperature, such as the mass of the product, and so do not need to measure product temperature.
- Some automatic tank gauging systems are capable of meeting the regulatory requirements for tank tightness testing and can be considered as an equivalent method.


#### ***What are the regulatory requirements?***

- The tightness test method must be able to detect a leak at least as small as 0.1 gallon per hour with certain probabilities of detection and of false alarm.
- Tightness tests must be performed periodically. New UST systems—those installed after December 1988—must have tank tightness tests every 5 years for 10 years following installation. In most cases, existing UST systems—those installed before December 1988—that have spill, overfill, and corrosion protection must have tank tightness tests every 5 years for 10 years following upgrade. See page 19 for some cases requiring fewer tightness tests. Existing UST systems that have not been upgraded must have tank tightness tests ***annually*** until December 1998, after which these tanks must be upgraded, replaced, or closed.
- After the applicable time period noted above, you must have a monitoring method that can be performed at least once per month. See the other sections of this booklet for allowable monthly monitoring options.

#### ***Anything else you should consider?***

- For most methods, the test is performed by a testing company. You just observe the test.
- Tank tightness testing has been used primarily on tanks no more than 15,000 gallons in capacity containing gasoline and diesel. If you are considering using tightness testing for larger tanks or products other than gasoline or diesel, discuss the method's applicability with the manufacturer's representative.
- Manifolded tanks generally should be disconnected and tested separately.
- Procedure and personnel, not equipment, are usually the most important factors in a successful tightness test. Therefore, well-trained and experienced testers are very important. Some states and local authorities have tester certification programs.

***Find out if there are state or local requirements on the use of these methods that differ from those described here.***

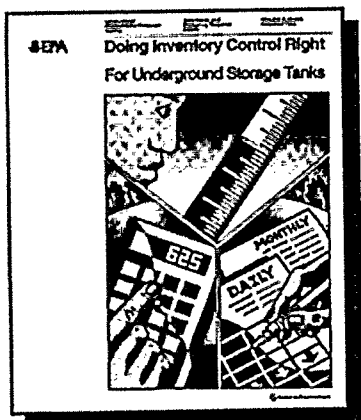

## Inventory Control

### *How does the leak detection method work?*

Inventory control requires frequent measurements of tank contents and math calculations that let you compare your "stick" inventory (what you've measured) to your "book" inventory (what your recordkeeping indicates you should have). Some people call this process "inventory reconciliation." If the difference between your "stick" and "book" inventory is too large, your tank may be leaking.

EPA has a booklet, **Doing Inventory Control Right**, that fully explains how to do inventory control. The booklet also contains standard recordkeeping forms. You can order this free booklet by calling EPA's toll-free Hotline at 800 424-9346. See inside the front cover for full ordering information.

- UST inventories are determined each operating day by using a gauge stick and recording the data on a form. The level on the gauge stick is converted to a volume of product in the tank using a calibration chart, which is often furnished by the UST manufacturer.
- The amounts of product delivered to and withdrawn from the UST each operating day are also recorded. At least once each month, the gauge stick data and the sales and delivery data are reconciled and the month's overage or shortage is determined. If the overage or shortage is greater than or equal to 1.0 percent of the tank's flow-through volume plus 130 gallons of product, the UST may be leaking.

### *What are the regulatory requirements?*

- Inventory control must be used in combination with periodic tank tightness tests.
- The gauge stick should reach the bottom of the tank and be marked so that the product level can be determined to the nearest one-eighth of an inch. A monthly measurement should be taken to identify any water at the bottom of the tank.
- Product dispensers must be calibrated to the local weights and measures standards.

### *Anything else you should consider?*

- Inventory control is a practical, commonly used management tool that does not require closing down the tank operation for long periods.
- The accuracy of tank gauging can be greatly increased by spreading product-finding paste on the gauge stick before taking measurements (or by using in-tank product level monitoring devices).
- If your tank is not level, inventory control may need to be modified. You will need to get a corrected tank chart.

### ***Time restrictions on the use of this combined method...***

Existing UST systems—those installed before December 1988—that have not been fully upgraded with spill, overfill, and corrosion protection must have tank tightness tests **annually** until December 1998, after which these tanks must be upgraded, replaced, or closed.

The combined method using tank tightness testing every 5 years is valid only after the entire UST system has met spill, overfill, and corrosion protection standards. Following entire UST system upgrade, this combined method may be used for 10 years (or until December 1998, whichever is later) after the date the tank was installed or upgraded with corrosion protection. Note that the end date is based on the compliance status of the **tank only**, not the entire UST system. As a result, some USTs may not be able to use this combined method for as long as 10 years (see discussion below). At the end of the valid time period, you must use one of the monthly monitoring leak detection choices described in this booklet.

### ***Unique time restriction for some existing USTs...***

For some existing USTs—those which had corrosion protection **before** the entire UST system met upgrade standards—this combined method of inventory control and tightness testing every 5 years may be valid for less than 10 years.

Federal regulations state that the combined method can be used:

1) until December 1998 or 10 years after the tank is protected from corrosion (whichever date is later), and 2) the period of validity cannot begin until the entire UST system meets upgrade standards. Therefore, in those cases where the tank had corrosion protection before the UST system met upgrade standards, the period of validity is less than 10 years. The effect of this restriction will be clear in the following example: a bare steel tank upgraded with corrosion protection in 1986 (or the tank was made of noncorrodible material and installed in 1986), but the piping, spill, and overfill upgrades were not added until 1995. The UST system in this example could start using the combined method only in 1995 (when the full system met upgrade standards) and could use the combined method only until 1998 (the date which is the later of either 1998 or 10 years after the tank has corrosion protection). In this example, the UST may use the combined method to meet federal leak detection requirements only for three years (from 1995 to 1998).


Correspondingly, when the period of validity is less than 10 years, fewer periodic tightness tests may be required.

***Check with your implementing agency for guidance.***

***The combined method  
can be used only  
temporarily.  
Be sure you know how  
long you can use the  
combined method to  
meet federal, state, or  
local requirements.***

## Manual Tank Gauging


### *Will you be in compliance?*

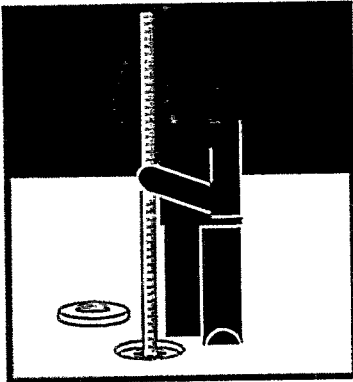

**NOTE:** *Manual tank gauging can be used only on tanks 2,000 gallons or less capacity. Tanks 1,000 gallons or less can use this method alone. Tanks from 1,001-2,000 gallons can temporarily use manual tank gauging only when it is combined with tank tightness testing. Manual tank gauging cannot be used on tanks over 2,000 gallons.* When performed according to recommended practices, manual tank gauging meets the federal leak detection requirements for USTs with a capacity of 1,000 gallons or less for the life of the tank. Manual tank gauging detects leaks only from **tanks** (this method does not detect piping leaks). For requirements for piping, see the section on leak detection for piping starting on page 22.

### *How does the leak detection method work?*

EPA has a booklet, **Manual Tank Gauging**, that fully explains how to do manual tank gauging correctly. The booklet also contains standard recordkeeping forms. You can order this free booklet by calling EPA's toll-free Hotline at 800 424-9346. See inside the front cover for complete ordering information.

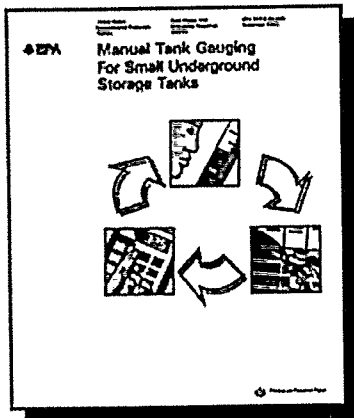

- Four measurements of the tank's contents must be taken weekly, two at the beginning and two at the end of **at least a 36-hour period** during which nothing is added to or removed from the tank. See the table on the next page.
- The average of the two consecutive ending measurements are subtracted from the average of the two beginning measurements to indicate the change in product volume.
- Every week, the calculated change in tank volume is compared to the standards shown in the table on the next page. If the calculated change exceeds the weekly standard, the UST may be leaking. Also, monthly averages of the four weekly test results must be compared to the monthly standard in the same way. See the table on the next page.

### *What are the regulatory requirements?*

- Liquid level measurements must be taken with a gauge stick that is marked to measure the liquid to the nearest one-eighth of an inch.
- Manual tank gauging may be used as the sole method of leak detection for tanks with a capacity of 1,000 gallons or less for the life of the tank. Tanks between 551 and 1,000 gallons have testing standards based on their diameter or their additional use of tightness testing (see table). These tanks may *temporarily* use a combination of manual tank gauging and periodic tank tightness (see next bullet on page 21).

**Table of Test Standards for Manual Tank Gauging**

<b>Tank Size</b>	<b>Minimum Duration Of Test</b>	<b>Weekly Standard (1 test)</b>	<b>Monthly Standard (4-test average)</b>
up to 550 gallons	36 hours	10 gallons	5 gallons
551-1,000 gallons (when tank diameter is 64")	44 hours	9 gallons	4 gallons
551-1,000 gallons (when tank diameter is 48")	58 hours	12 gallons	6 gallons
551-1,000 gallons (also requires periodic tank tightness testing)	36 hours	13 gallons	7 gallons
1,001-2,000 gallons (also requires periodic tank tightness testing)	36 hours	26 gallons	13 gallons

- For tanks with a capacity of 1,001-2,000 gallons, manual tank gauging must be combined with periodic tightness testing. This combined method will meet the federal requirements only **temporarily**. See page 19 for an explanation of time restrictions that also applies to the combination of manual tank gauging and tank tightness testing. You must eventually have another monitoring method that can be performed at least once a month. See the other sections of this booklet for allowable monthly monitoring options. Also, see pages 16-17 on tank tightness testing for details on this method.
- Tanks greater than 2,000 gallons in capacity may not use this method of leak detection to meet these regulatory requirements.

***Anything else you should consider?***

- You can perform manual tank gauging yourself. Correct gauging, recording, and math are the most important factors for successful tank gauging. The accuracy of tank gauging can be greatly increased by spreading product-finding paste on the gauge stick before taking measurements.

## Leak Detection For Underground Piping

### *Will you be in compliance?*


When installed and operated according to the manufacturer's specifications, the leak detection methods discussed here meet the federal regulatory requirements for the life of underground piping systems. Your UST may have **suction** or **pressurized** piping, which are discussed below.

### *What are the regulatory requirements for suction piping?*

- No leak detection is required if the suction piping has (1) enough slope so that the product in the pipe can drain back into the tank when suction is released and (2) has only one check valve, which is as close as possible beneath the pump in the dispensing unit. If a suction line is to be considered exempt based on these design elements, there must be some way to check that the line was actually installed according to these plans.
- If a suction line does not meet all of the design criteria noted above, one of the following leak detection methods must be used:
  - A line tightness test at least every 3 years; or
  - Monthly interstitial monitoring; or
  - Monthly vapor monitoring; or
  - Monthly groundwater monitoring; or
  - Monthly statistical inventory reconciliation; or
  - Other monthly monitoring that meets performance standards.

The line tightness test must be able to detect a leak at least as small as 0.1 gallon per hour at 1.5 times normal operating pressure with certain probabilities of detection and of false alarm.

Interstitial monitoring, vapor monitoring, groundwater monitoring, and statistical inventory reconciliation have the same regulatory requirements for piping as they do for tanks. See the earlier sections of this booklet on those methods.

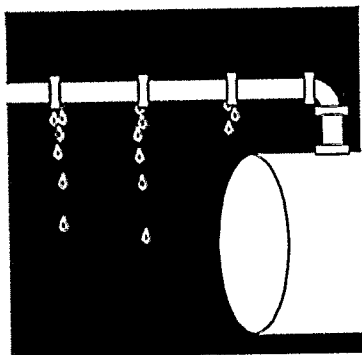

## ***What are the regulatory requirements for pressurized piping?***

Each pressurized piping run must have one leak detection method from each set below:

### **An Automatic Line Leak Detector:**

- ▶ Automatic flow restrictor; or
- ▶ Automatic flow shutoff; or
- ▶ Continuous alarm system.

### **And One Other Method:**

- ▶ Annual line tightness test; or
- ▶ Monthly interstitial monitoring; or
- ▶ Monthly vapor monitoring; or
- ▶ Monthly groundwater monitoring; or
- ▶ Monthly statistical inventory reconciliation; or
- ▶ Other monthly monitoring that meets performance standards.

*Find out if there are state or local requirements on the use of leak detection methods for piping that differ from those described here.*

- The automatic line leak detector (LLD) must be designed to detect a leak at least as small as 3 gallons per hour at a line pressure of 10 pounds per square inch within 1 hour by shutting off the product flow, restricting the product flow, or triggering an audible or visual alarm.
- The line tightness test must be able to detect a leak at least as small as 0.1 gallon per hour when the line pressure is 1.5 times its normal operating pressure. The test must be conducted each year. If the test is performed at pressures lower than 1.5 times operating pressure, the leak rate to be detected must be correspondingly lower.
- Automatic LLDs and line tightness tests must also be able to meet the federal regulatory requirements regarding probabilities of detection and false alarm.
- Interstitial monitoring, vapor monitoring, groundwater monitoring, and statistical inventory reconciliation have the same regulatory requirements for piping as they do for tanks. See the earlier sections of this booklet on those methods.

## ***How do the leak detection methods work?***

### **Automatic line leak detectors (LLDs)**

- Flow restrictors and flow shutoffs can monitor the pressure within the line in a variety of ways: whether the pressure decreases over time; how long it takes for a line to reach operating pressure; and combinations of increases and decreases in pressure.

- If a suspected leak is detected, a *flow restrictor* keeps the product flow through the line well below the usual flow rate. If a suspected leak is detected, a *flow shutoff* completely cuts off product flow in the line or shuts down the pump.
- A *continuous alarm system* constantly monitors line conditions and immediately triggers an audible or visual alarm if a leak is suspected. Automated internal, vapor, or interstitial line monitoring systems can also be set up to operate continuously and sound an alarm, flash a signal on the console, or even ring a telephone in a manager's office when a leak is suspected.
- Both automatic flow restrictors and shutoffs are permanently installed directly into the pipe or the pump housing.
- Vapor, interstitial, or other monitoring systems can be installed to shut off flow, restrict flow, or trigger an alarm whenever a leak is detected. If it meets the applicable standards, such a setup meets the monthly monitoring requirement as well as the LLD requirement.

#### **Line tightness testing**


- Tracer methods do not measure pressure or flow rates of the product. Instead they use a tracer chemical to determine if there is a hole in the line. With tracer methods, all of the factors below may not apply.
- The line is taken out of service and pressurized, usually above the normal operating pressure. A drop in pressure over time, usually an hour or more, suggests a possible leak.
- Suction lines are not pressurized very much during a tightness test (about 7 to 15 pounds per square inch).
- Most line tightness tests are performed by a testing company. You just observe the test.
- Some *tank* tightness test methods can be performed to include a tightness test of the connected piping.
- For most line tightness tests, no permanent equipment is installed.
- In the event of trapped vapor pockets, it may not be possible to conduct a valid line tightness test. There is no way to tell definitely before the test begins if this will be a problem, but long complicated piping runs with many risers and dead ends are more likely to have vapor pockets.
- Some permanently installed electronic systems (which often include ATGS) can meet the requirements of monthly monitoring or a line tightness test.

### **Secondary containment with interstitial monitoring**

- A barrier is placed between the piping and the environment. Double-walled piping or a leakproof liner in the piping trench can be used.
- A monitor is placed between the piping and the barrier to sense a leak if it occurs. Monitors range from a simple stick that can be put in a sump to see if a liquid is present, to continuous automated systems that monitor for the presence of liquid product or vapors.
- Proper installation of secondary containment is the most important and the most difficult aspect of this leak detection method. Trained and experienced installers are necessary.
- See the section on secondary containment for additional information. Secondary containment for piping is similar to that for tanks.

### **Vapor or groundwater monitoring**

- Vapor monitoring detects product that leaks into the soil and evaporates.
- Groundwater monitoring checks for leaked product floating on the groundwater near the piping.
- A site assessment must be used to determine monitoring well placement and spacing.
- UST systems using vapor or groundwater monitoring for the tanks are well suited to use the same monitoring method for the piping.
- See the earlier sections on vapor and groundwater monitoring. Use of these methods with piping is similar to that for tanks.

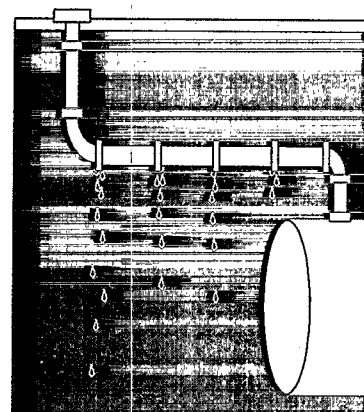

## ***Free Publications About UST Requirements***

**AVAILABLE FREE...** You can go to our Web site at <http://www.epa.gov/oust/> to order or read documents online. You can call EPA's toll-free RCRA/Superfund Hotline at 800 424-9346 and order *up to 30 free copies*. Or you can write and ask for titles by addressing your request to NCEPI, our publication distributor: NCEPI, Box 42419, Cincinnati, OH 45242. Or you can make your request by calling NCEPI's toll-free number at 800 490-9198. Or you can fax your order to NCEPI at 513 891-6685. If you want *more than 30 copies*, contact Jay Evans at 703 603-7149.

### **TITLES**

---

#### **Musts For USTs: A Summary Of Federal Regulations For Underground Storage Tank Systems**

Booklet clearly summarizes federal UST requirements for installation, release detection, spill, overfill, and corrosion protection, corrective action, closure, reporting and recordkeeping. Updated & revised 1995 (36 pages). Also available as **Normas y Procedimientos para T.S.A.**, Spanish translation of 1988 edition of **Musts For USTs** (40 pages).

#### **Straight Talk On Tanks: Leak Detection Methods For Petroleum Underground Storage Tanks**

Booklet explains federal regulatory requirements for leak detection and briefly describes allowable leak detection methods. Updated & revised 1995 (28 pages).

#### **Doing Inventory Control Right: For Underground Storage Tanks**

Booklet describes how owners and operators of USTs can use inventory control and periodic tightness testing to meet federal leak detection requirements. Contains reporting forms (16 pages).

#### **Manual Tank Gauging: For Small Underground Storage Tanks**

Booklet provides simple, step-by-step directions for conducting manual tank gauging for tanks 2,000 gallons or smaller. Contains reporting forms (12 pages).

#### **Introduction To Statistical Inventory Reconciliation: For Underground Storage Tanks**

Booklet describes how Statistical Inventory Reconciliation (SIR) can meet federal leak detection requirements (12 pages).

#### **Don't Wait Until 1998: Spill, Overfill, And Corrosion Protection For Underground Storage Tanks**

Information to help owners and operators of USTs meet the 1998 deadline for compliance with requirements to upgrade, replace, or close USTs installed before December 1988. Materials available as a 16-page booklet, a trifold leaflet, or Spanish translation of the booklet (*No Espere Hasta El 1998*).

#### **Are You Upgrading An Underground Storage Tank System?**

Trifold leaflet can help UST owners and operators make sound decisions about choosing tank integrity assessment methods and upgrading USTs to meet 1998 deadline requirements.

#### **Closing Underground Storage Tanks: Brief Facts**

Trifold leaflet presents "brief facts" on properly closing USTs in order to comply with federal closure requirements.

#### **Dollars And Sense: Financial Responsibility Requirements For Underground Storage Tanks**

Booklet summarizes the "financial responsibility" required of UST owners and operators (16 pages).

#### **An Overview Of Underground Storage Tank Remediation Options**

Information about technologies for remediating petroleum contamination in soil and groundwater (26 pages).

#### **Controlling UST Cleanup Costs**

Fact sheet series on the cleanup process includes: *Hiring a Contractor*, *Negotiating the Contract*, *Interpreting the Bill*, *Managing the Process*, and *Understanding Contractor Code Words* (10 pages).

#### **Pay-For-Performance Cleanups: Effectively Managing Underground Storage Tank Cleanups**

Booklet explores potential advantages of using pay-for-performance cleanup agreements to reduce the cost and time of cleanups and more effectively manage cleanup resources (32 pages).

#### **Financing Underground Storage Tank Work: Federal And State Assistance Programs**

Booklet identifies potential sources of financial assistance to cover the costs of upgrading, replacing, or closing an UST, or of cleaning up an UST release (30 pages).

## Videos About UST Requirements

There are several helpful videos you can order, at cost, as explained below:

### VIDEOS TITLE/COST

### AVAILABLE FROM

#### **Tank Closure Without Tears: An Inspector's Safety Guide**

Focuses on explosive vapors and safe tank removal (30 minutes).

Video and Booklet Cost: \$35; Booklet: \$5

New England Interstate  
Environmental Training Center  
ATTN:VIDEOS  
2 Fort Road  
South Portland, ME 04106  
207 767-2539

#### **What Do We Have Here?: An Inspector's Guide To Site Assessment At Tank Closure**

Inspecting sites for contamination where tanks have been removed.

Part 1: Site Assessment Overview (30 minutes); Part 2: Field Testing Instruments At A Glance (14 minutes); Part 3: Soil And Water Sampling

At A Glance (7 minutes). Video and Booklet Cost: \$45; Booklet: \$5

#### **Searching For The Honest Tank: A Guide To UST Facility Compliance Inspection**

Covers major aspects of UST inspections, including protocols, equipment, cathodic protection, and leak detection. Directed at inspectors, yet also helpful to owners and operators (30 minutes). Video and Booklet Cost: \$40; Booklet: \$5

#### **Tank Time**

Humorous presentation explains what UST owners and operators must do to comply with the December 1998 deadline to upgrade, replace, or close tanks installed before December 1988 (18 minutes). Cost: \$24

Scene Three, Inc.  
ATTN: "Tank Time"  
1813 Eighth Avenue, South  
Nashville, TN 37203  
615 385-2820

#### **Doing It Right**

Illustrates proper installation of underground tanks and piping for installation crews. Part 1: Tanks (24 minutes); Part 2: Piping (16 minutes).

Contact EPA's Hotline at  
**800 424-9346** for cost and ordering  
information.

#### **Doing It Right II: Installing Required UST Equipment**

Illustrates installation of spill and overfill equipment, observation wells, and piping leak detection (23 minutes).

#### **Keeping It Clean: Making Safe And Spill-Free Motor Fuel Deliveries**

Making pollution-free deliveries to USTs. Includes Stage 1 vapor recovery, overfill prevention and spill containment. For fuel tanker drivers and UST owner/operators (25 minutes).

#### **Petroleum Leaks Underground**

How liquids and vapors move in the subsurface and why early response to leaked petroleum is so important. Part 1: How Liquids Move (14 minutes); Part 2: How Vapors Move (15 minutes).

#### **Straight Talk on Leak Detection**

Overview of the leak detection methods available for complying with federal regulations (30 minutes).

#### **RBCA: Initial Site Assessment**

Overview of risk-based corrective action process produced by Shell Oil Company (25 minutes).

## State UST Program Offices

### Alabama

Alabama Dept. of Env.  
Mgt./Groundwater Section/  
Water Div.  
1751 Cong. Dickinson Dr.  
Montgomery, AL 36130  
Phone:(334)271-7986  
Fax:(334)271-7950

### Alaska

Alaska Dept. of Env.  
Conservation  
410 Willoughby Ave.  
Juneau, AK 99801-1795  
Phone:(907)465-5203  
Fax:(907)465-5218

### Arkansas

Arkansas Dept. of Pollution  
Control & Ecology  
Regulated Storage Tanks  
P.O. Box 8913  
8101 Interstate 30,Bldg D  
Little Rock, AR 72219-8913  
Phone:(501)682-0744  
Fax:(501)682-0880

### Arizona

Arizona Dept. of Env. Quality  
3033 North Central Ave.  
Phoenix, AZ 85012  
Phone:(602)207-4324  
Fax:(602)207-4346

### California

California State Water Resources  
Control Board  
Div. of Clean Water Programs  
P.O. Box 944212  
Sacramento, CA 94244-2120  
Phone:(916)227-4313  
Fax:(916)227-4349

### Colorado

Colorado State Oil Inspection  
1515 Arapahoe St.  
Tower 3, Suite 600  
Denver, CO 80202-2117  
Phone:(303)620-4300  
Fax:(303)620-4028

### Connecticut

Connecticut Dept. of Env.  
Protection/Waste Mgt. Bureau  
State Office Bldg.  
79 Elm Street  
Hartford, CT 06106  
Phone:(860)424-3374  
Fax:(860)424-4057

### Delaware

Delaware Dept. of Natural  
Resources & Env.Control  
UST Branch  
715 Grantham Lane  
New Castle, DE 19720-4801  
Phone:(302)323-4588  
Fax:(302)323-4561

### District of Columbia

D.C. Env. Reg. Adm./ Haz. Waste &  
UST Division  
2100 Martin Luther King Ave.,SE--  
Suite 203  
Washington, DC 20020  
Phone:(202)645-6080  
Fax:(202)645-6622

### Florida

Florida Dept. of Env.  
Regulation/Tank Section  
Twin Towers Bldg.; Room 403  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400  
Phone:(904)488-3935  
Fax:(904)922-4939

### Georgia

Georgia Dept. of Natural  
Resources/UST Mgt. Program  
4244 Inter. Parkway; Suite 100  
Atlanta, GA 30354  
Phone:(404)362-4877  
Fax:(404)362-2654

### Hawaii

Hawaii Dept. of Health  
Solid and Hazardous Waste Br.  
919 Ala Moana Blvd.; Suite 212  
Honolulu, HI 96814  
Phone:(808)586-4226  
Fax:(808)586-7509

### Idaho

Idaho Div. of Env. Quality  
1410 North Hilton  
Boise, ID 83706  
Phone:(208)373-0502  
Fax:(208)373-0576

### Illinois

Illinois Office of State Fire  
Marshal/Div. of Petroleum &  
Chemical Safety  
1035 Stephenson Dr.  
Springfield, IL 62703  
Phone:(217)785-5878  
Fax:(217)782-1062

### Indiana

Indiana Dept. of Env. Mgmt./Office  
of Env. Response  
100 N. Senate Ave.  
Indianapolis, IN 46206  
Phone:(317)308-3060  
Fax:(317)233-0909

### Iowa

Iowa Dept. of Natural  
Resources/UST Section  
Wallace State Office Bldg.  
900 East Grand  
Des Moines, IA 50319  
Phone:(515)281-8135  
Fax:(515)281-7212

### Kansas

Kansas Dept. of Health &  
Env./Bureau Env. Remed./ Storage  
Tank Section  
Forbes Field, Bldg. 740  
Topeka, KS 66620  
Phone:(913)296-1678  
Fax:(913)296-6190

### Kentucky

Kentucky Division of Waste  
Management/UST Branch  
14 Reilly Road  
Frankfort, KY 40601  
Phone:(502)564-6716  
Fax:(502)564-4245

### Louisiana

Louisiana Dept. of Env.  
Quality/UST Division  
P.O. Box 82178  
Baton Rouge, LA 70884-2178  
Phone:(504)765-0243  
Fax:(504)765-0366

### Maine

Maine Dept. of Env. Protection  
Bur. Remediation & Waste Mgt.  
Ray Bldg., Station #17  
Augusta, ME 04333  
Phone:(207)287-2651  
Fax:(207)287-7826

### Maryland

Maryland Dept. of Env.  
Waste Mgt. Admin.  
Oil Control Program  
2500 Broening Highway  
Baltimore, MD 21224  
Phone:(410)631-3442  
Fax:(410)631-3092

### Massachusetts

Massachusetts Dept. of Public  
Safety/UST Program  
One Ashburton Place; Rm 1310  
Boston, MA 02108  
Phone:(617)727-3200  
Fax:(617)727-4390

### Michigan

Michigan Dept. of Env.  
Quality/UST Division  
P.O. Box 30157  
Lansing, MI 48909-7657  
Phone:(517)373-8168  
Fax:(517)335-2245

### Minnesota

Minnesota Pollution Control  
Agency/UST Program  
520 Lafayette Road North  
St. Paul, MN 55155-3898  
Phone:(612)297-8608  
Fax:(612)297-8676

### Mississippi

Mississippi Dept. of Env. Quality  
Bureau of Pollution Control  
UST Section  
P.O. Box 10385  
Jackson, MS 39289-0385  
Phone:(601)961-5171  
Fax:(601)354-6612

### Missouri

Missouri Dept. of Natural  
Resources/Haz. Waste  
Program/Tanks Section  
P.O. Box 176  
Jefferson City, MO 65102-0176  
Phone:(573)751-6822  
Fax:(573)562-8922

### Montana

Montana Dept. of Env. Quality  
Waste Management Div.  
P.O. Box 200901  
Helena, MT 59620-0901  
Phone:(406)444-5970  
Fax:(406)444-1902

### Nebraska

Nebraska State Fire Marshal  
Flammable Liquid Storage  
246 South 14th Street  
Lincoln, NE 68508  
Phone:(402)471-9465  
Fax:(402)471-3118

### Nevada

Nevada Dept. of Cons. & Nat.  
Resources/Div. of Env.Prot.  
Capitol Complex  
333 W. Nye Lane  
Carson City, NV 89710  
Phone:(702)687-5872  
Fax:(702)687-6396

### New Hampshire

New Hampshire Dept. of  
Env. Services/Groundwater  
Protection Bureau  
P.O. Box 95  
6 Hazen Drive  
Concord, NH 03302  
Phone:(603)271-3644  
Fax:(603)271-2181

# State UST Program Offices

## **New Jersey**

New Jersey Dept. of Env. Prot. and  
Energy/Responsible Party Site  
Remediation  
401 East State St. (CN-028)  
Trenton, NJ 08625-0028  
Phone: (609)292-8761  
Fax: (609)633-1454

## **New Mexico**

New Mexico Env. Dept.  
UST Bureau  
P.O. Box 26110  
H. Runnels Bldg., Rm N2150  
Santa Fe, NM 87504-0968  
Phone: (505)827-2932  
Fax: (505)827-0310

## **New York**

New York Dept. of Env. Cons./Bulk  
Storage Section  
50 Wolf Road, Rm 340  
Albany, NY 12233-3750  
Phone: (518)457-4351  
Fax: (518)457-4332

## **North Carolina**

North Carolina Pollution Control  
Branch/Div. of Env. Mgt./Dept. Env.  
Health & Natural Resources  
441 N. Harrington St.  
Raleigh, NC 27603  
Phone: (919)733-8486  
Fax: (919)733-9413

## **North Dakota**

Div. of Waste Mgt./North Dakota  
Dept. of Health  
UST Program  
1200 Missouri Ave.  
P.O. Box 5520  
Bismarck, ND 58506-5520  
Phone: (701)328-5166  
Fax: (701)328-5200

## **Ohio**

Ohio Dept. of Commerce  
Bureau of UST Regulations  
P.O. Box 687  
6606 Tusling Road  
Reynoldsburg, OH 43068-9009  
Phone: (614)752-7938  
Fax: (614)752-7942

## **Oklahoma**

Oklahoma Corp. Commission  
Fuel Storage Div.  
Jim Thorpe Bldg.  
2101 North Lincoln Blvd.  
Oklahoma City, OK 73105  
Phone: (405)521-3107  
Fax: (405)521-6576

## **Oregon**

Oregon Dept. of Env.  
Quality/UST Program  
811 SW Sixth Ave., 9th Floor  
Portland, OR 97204  
Phone: (503)229-5733  
Fax: (503)229-6954

## **Pennsylvania**

Pennsylvania Dept. of  
Env. Prot./Bureau of Water Quality  
Mgt./Storage Tank Prgrm  
Rachel Carson State Off. Bldg.  
P.O. Box 8762  
Harrisburg, PA 17105-8762  
Toll-free UST: 1-800-42TANKS  
Phone: (717)772-5599  
Fax: (717)772-5598

## **Rhode Island**

Dept. of Env. Mgt./UST Section  
291 Promenade St.  
Providence, RI 02908  
Phone: (401)277-2234  
Fax: (401)521-4230

## **South Carolina**

South Carolina Dept. of Health  
and Env. Control/Bureau of UST  
Management  
2600 Bull St.  
Columbia, SC 29201  
Phone: (803)734-5331  
Fax: (803)734-3604

## **South Dakota**

South Dakota Dept. of Env. & Nat.  
Resources/UST Program  
523 East Capitol  
Pierre, SD 57501  
Phone: (605)773-3296  
Fax: (605)773-6035

## **Tennessee**

Tennessee Dept. of Env. and  
Conservation/Div. of USTs  
4th Floor, L & C Tower  
401 Church St.  
Nashville, TN 37243-1541  
Phone: (615)532-0945  
Fax: (615)532-0938

## **Texas**

Texas Natural Resources  
Conservation Commission  
Petroleum Storage Tank Div.  
MC: 133  
P.O. Box 13087  
Austin, TX 78711-3087  
Phone: (512)239-2106  
Fax: (512)239-2177

## **Utah**

Utah Dept. of Env. Quality  
Div. of Env. Response and  
Remediation/UST Branch  
P.O. Box 144840  
Salt Lake City, UT 84114-4840  
Phone: (801)536-4100  
Fax: (801)359-8853

## **Vermont**

Dept. of Env. Conservation  
Haz. Materials Mgt. Div.  
103 South Main St.  
Waterbury, VT 05676  
Phone: (802)241-3882  
Fax: (802)244-5141

## **Virginia**

Virginia Dept. of Env. Quality  
Underground Storage Tanks  
P.O. Box 10009  
Richmond, VA 23240  
Phone: (804)698-4313  
Fax: (804)698-4266

## **Washington**

Washington Dept. of Ecology  
Toxics Cleanup Program  
P.O. Box 47600  
Olympia, WA 98504-7600  
Phone: (360)407-7170  
Fax: (360)407-7154

## **West Virginia**

West Virginia Div. of  
Env. Protection/Office of Waste  
Mgt./UST Section  
1356 Hansford St.  
Charleston, WV 25301  
Phone: (304)558-6371  
Fax: (304)558-2387

## **Wisconsin**

Wisconsin Dept. of Commerce  
Env. & Reg. Services Div.  
P.O. Box 7969  
201 East Washington Ave.  
Madison, WI 53707-7969  
Phone: (608)266-7874  
Fax: (608)267-0592

## **Wyoming**

Wyoming Dept. Of Env. Quality  
Water Quality Division  
Herschler Bldg., 4th Floor West  
122 West 25th St.  
Cheyenne, WY 82002  
Phone: (307)777-7096  
Fax: (307)777-5973

## **U.S. Territories**

### **American Samoa**

American Samoa Env.  
Protection Agency  
Office of the Governor  
American Samoa Government  
ATTN: UST Program  
Pago Pago, AS 96799  
Phone: 011-684-633-2304  
Fax: 011-684-633-5801

### **Northern Mariana Islands**

Div. of Environmental Quality  
Commonwealth of Northern  
Mariana Islands  
P.O. Box 1304  
3rd Floor, Morgens Bldg.  
San Jose  
Saipan, MP 96950  
Phone: 011-670-234-1011  
Fax: 011-670-234-1003

### **Guam**

Guam Env. Protection Agency  
IT&E; Harmon Plaza  
Complex Unit D-107  
130 Rojas St.  
Harmon, GU 96911  
Phone: 011-671-646-8863  
Fax: 011-671-646-9402

### **Puerto Rico**

Environmental Quality Board  
P.O. Box 11488  
Commonwealth of Puerto Rico  
Santurce, PR 00910  
Phone: (787)767-8109  
Fax: (787)767-1962

### **Virgin Islands**

Div. of Env. Protection/Dept. of  
Planning and Nat. Resources  
396-1 Foster Plaza  
Annas Retreat  
Charlotte Amalie  
St. Thomas, VI 00802  
Phone: (809)774-3320  
Fax: (809)775-5706



United States

Environmental Protection

Agency

6403W

Washington, DC 20460

Official Business

Penalty for Private Use

\$800